




STANDARD INLET PLAN

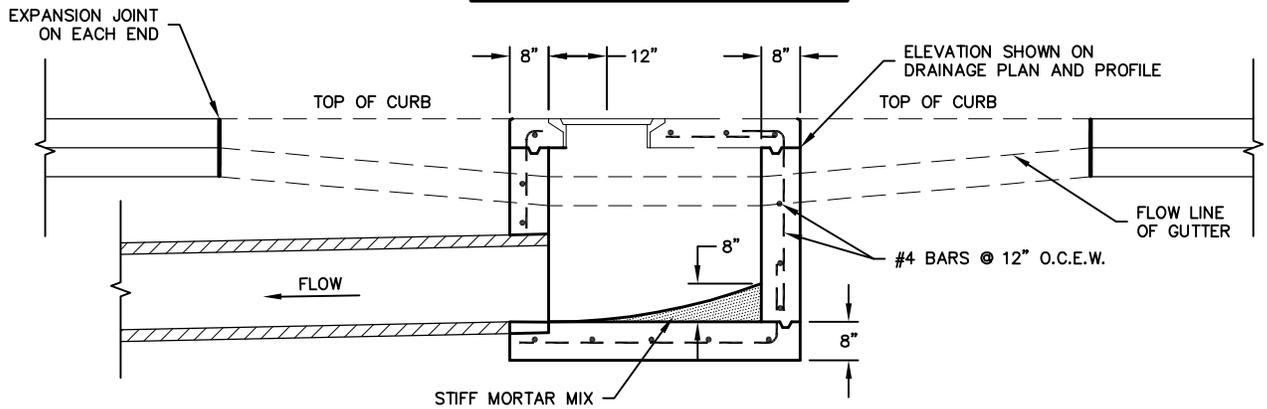

SECTION A-A

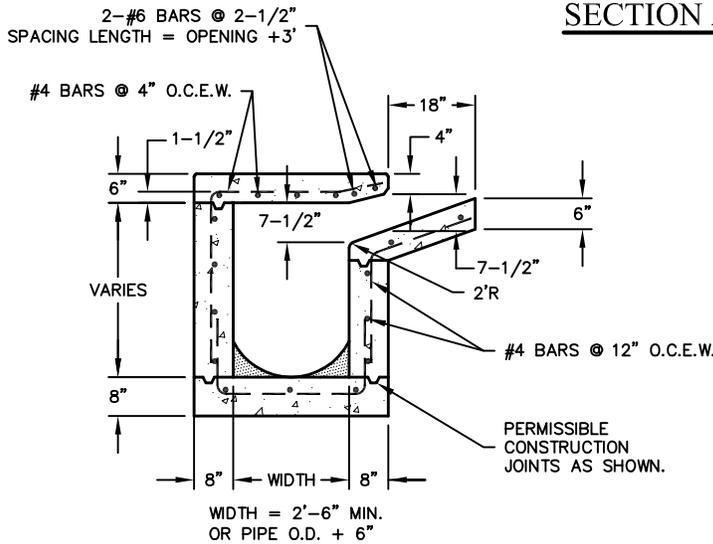

SECTION B-B

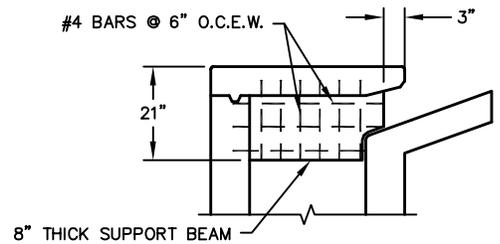

CENTER SUPPORT BEAM FOR INLETS OVER 10'

GENERAL NOTES:

1. ALL CONCRETE SHALL BE CLASS "C"
2. TOOL ALL EXPOSED EDGES TO 3/4" RADIUS.
3. LAP ALL STEEL 12" MINIMUM.
4. ALL CONSTRUCTION SHALL CONFORM TO ITEM 502.12 STORM SEWER APPURTENANCES.
5. ALL REINFORCING STEEL SHALL HAVE 1 1/2" COVER.
6. ALL INLETS OVER 10 FEET SHALL HAVE 8"X 8" CHAMFERED SUPPORT POSTS AT CENTER.
7. GROUT BOTTOM OF INLET TO PROVIDE POSITIVE DRAINAGE.

STANDARD CURB INLET
NOT TO SCALE

APPROVED

CITY OF WICHITA FALLS, TX
ENGINEERING DIVISION

STANDARD
CURB INLET

CITY ENGINEER

DATE

MARCH 2019

DETAIL NO. 6020

DISCLAIMER: The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.