


DISCLAIMER:

The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

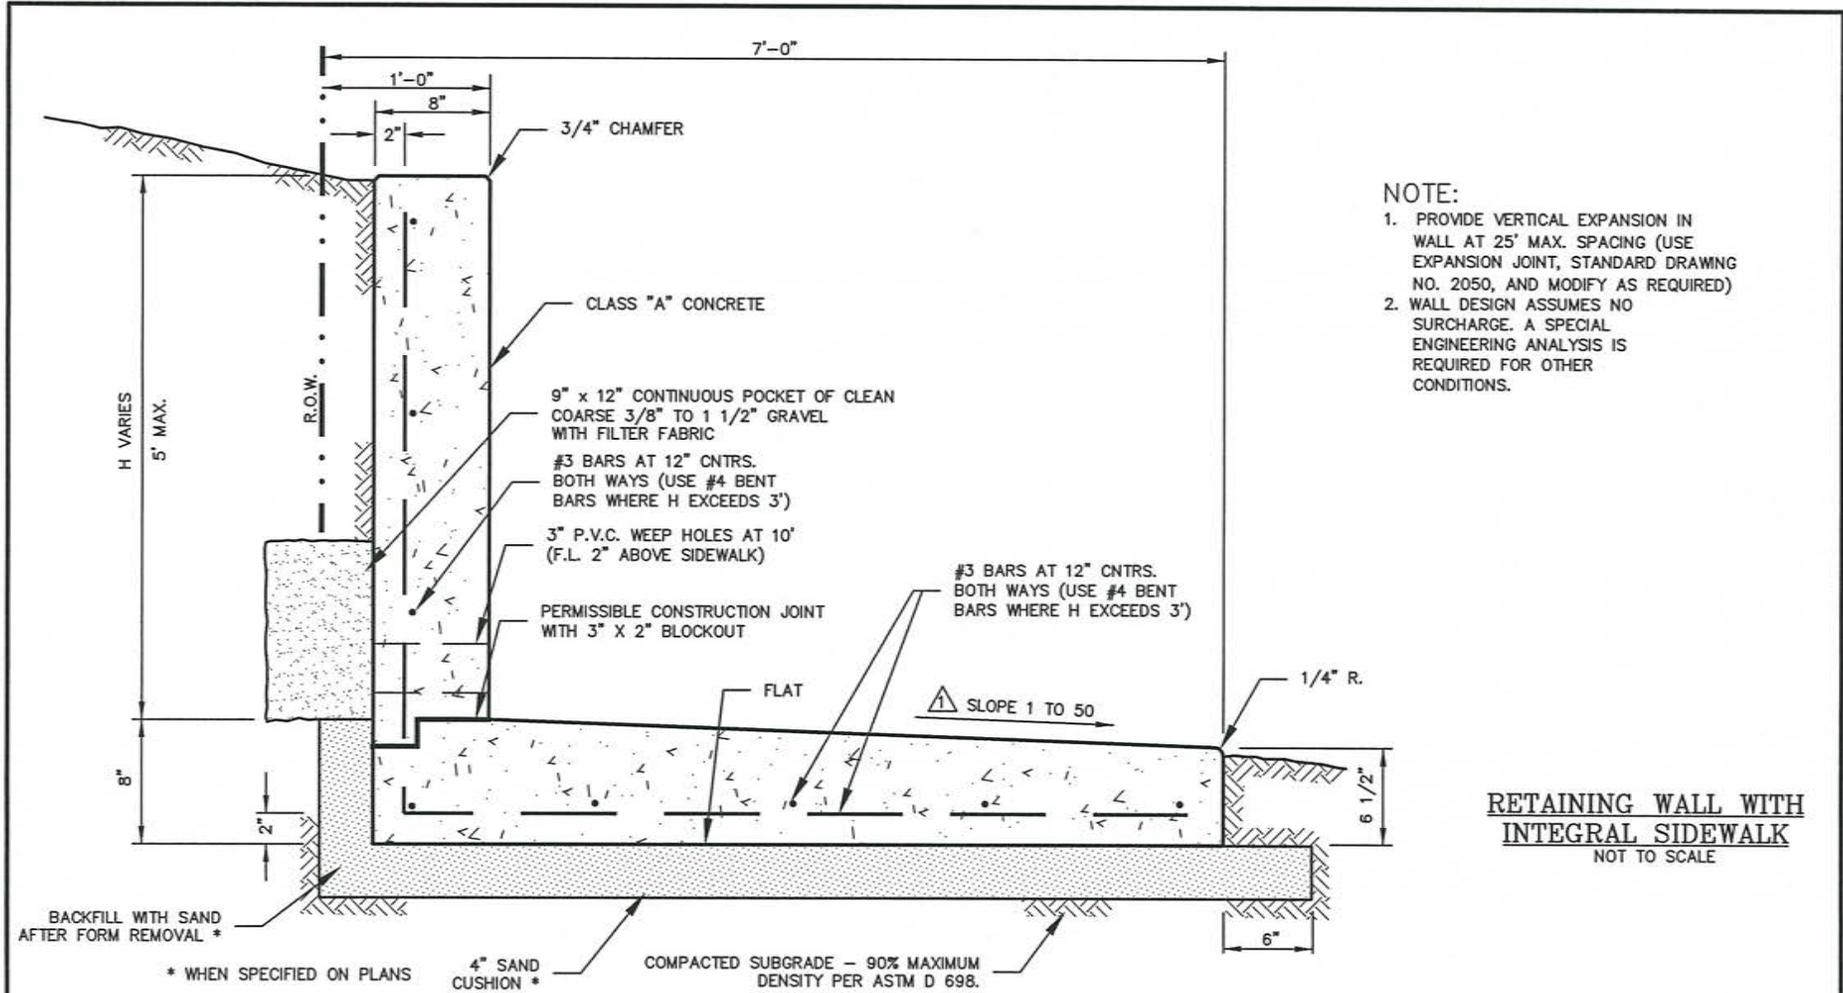

NOTE:

1. PROVIDE VERTICAL EXPANSION IN WALL AT 25' MAX. SPACING (USE EXPANSION JOINT, STANDARD DRAWING NO. 2050, AND MODIFY AS REQUIRED)
2. WALL DESIGN ASSUMES NO SURCHARGE. A SPECIAL ENGINEERING ANALYSIS IS REQUIRED FOR OTHER CONDITIONS.

RETAINING WALL WITH INTEGRAL SIDEWALK
NOT TO SCALE

	DEC 03	2180-00	CITY OF WICHITA FALLS, TX	
	DATE DRAWN	STANDARD DRAWING NO.	REINFORCED CONCRETE RETAINING WALL INTEGRAL WITH SIDEWALK	
Sidewalk-W-Ret-Wall ACAD DRAWING NAME	△ 03/05	SLOPE CHANGE	APPROVED	
	NO. DATE	DESCRIPTION	BY	
	R E V I S I O N S		CITY ENGINEER	MAR 2005 DATE