


EMBEDDING DETAIL

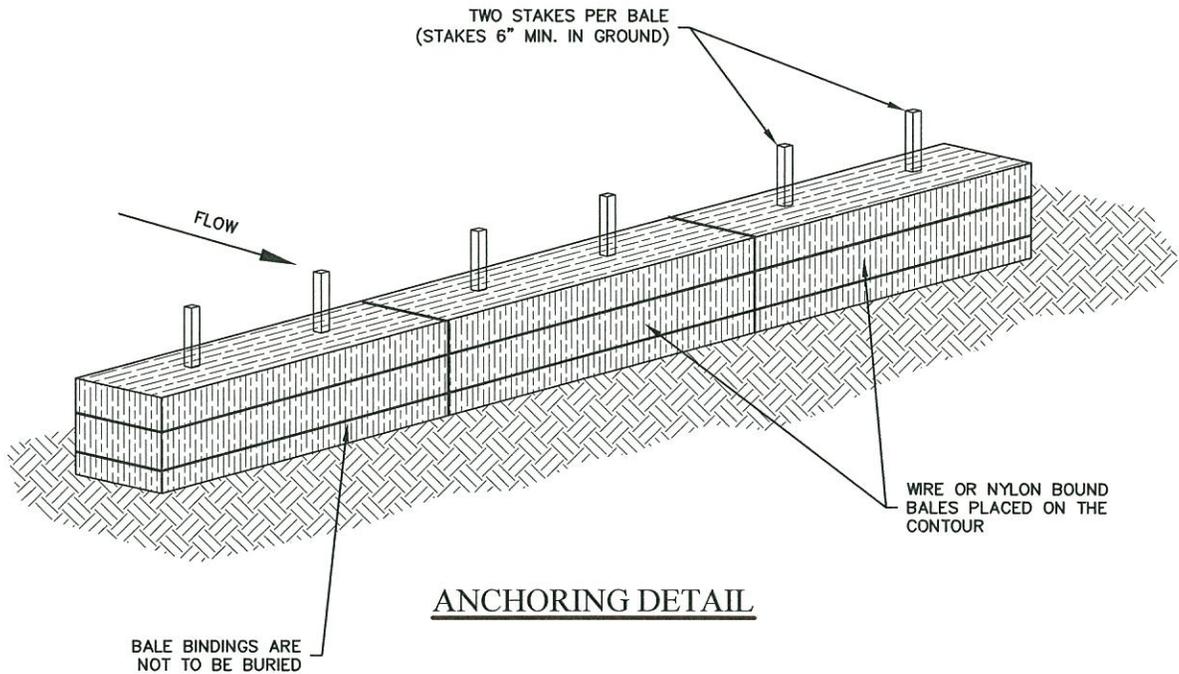

ANCHORING DETAIL

GENERAL NOTES:

1. EACH BALE SHALL BE EMBEDDED IN THE SOIL A MINIMUM OF FOUR INCHES.
2. BALES SHALL BE SECURELY ANCHORED IN PLACE BY 2" X 2" WOOD STAKES DRIVEN THROUGH THE BALES.
3. INSPECTION SHALL BE MADE EVERY TWO WEEKS AND AFTER EACH 1/2" RAINFALL EVENT. REPAIR OR REPLACEMENT SHALL BE MADE PROMPTLY AS NEEDED BY THE CONTRACTOR.
4. WHEN SILT REACHES A DEPTH OF 6 INCHES, IT SHALL BE REMOVED AND DISPOSED OF IN AN APPROVED MANNER.
5. AFTER THE DISTURBED AREAS OF THE SITE ARE COMPLETELY STABILIZED, THE BALES SHALL BE REMOVED AND DISPOSED OF AT AN APPROVED SPOIL DISPOSAL SITE.

STRAW BALE DIKE

NOT TO SCALE

DISCLAIMER: The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

APPROVED  CITY ENGINEER	CITY OF WICHITA FALLS, TX ENGINEERING DIVISION JANUARY 2015	STRAW BALE DIKE DETAIL NO. 1060
12-10-14 DATE		