2130 – CONCRETE VALLEY GUTTER .DWG

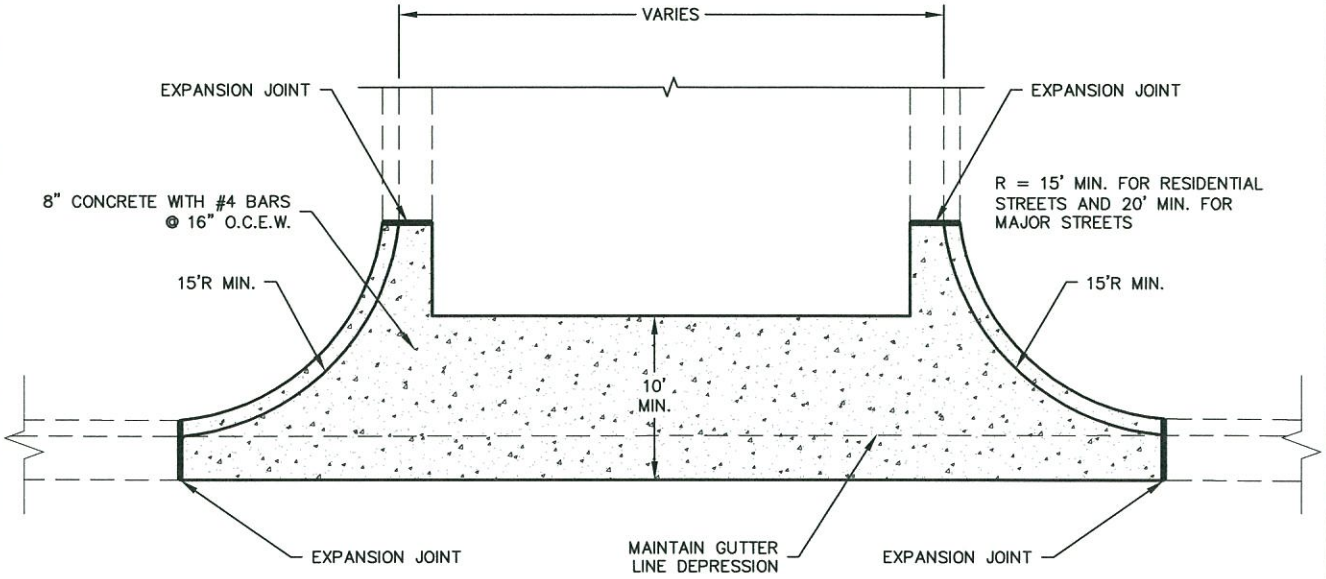

INTERSECTION VALLEY GUTTER

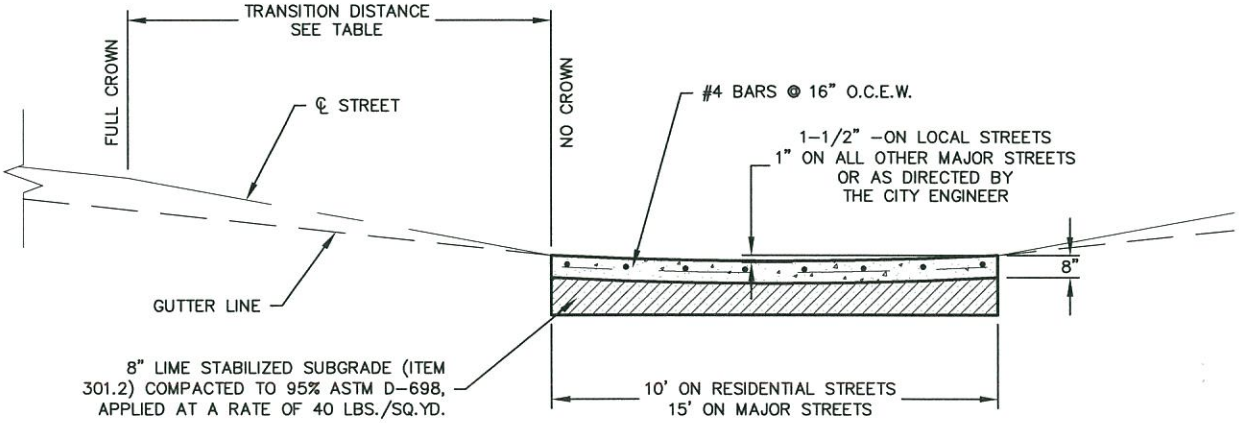

CROWN OF ROADWAY (in.)	TRANSITION DISTANCE (ft.)
0"	0'
1"	10'
2"	20'
3"	30'
4"	40'
5"	50'

MIDSTREET VALLEY GUTTER

GENERAL NOTES:

1. ALL CONCRETE SHALL BE CLASS "C" (COMPRESSIVE STRENGTH OF 3600 PSI @ 28 DAYS).
2. ALL EXPOSED CONCRETE SURFACES SHALL BE CURED IN ACCORDANCE WITH ITEM 303.5.7 OF THE STANDARD SPECIFICATIONS.

CONCRETE VALLEY GUTTER

NOT TO SCALE

APPROVED	CITY OF WICHITA FALLS, TX ENGINEERING DIVISION	CONCRETE VALLEY GUTTER
CITY ENGINEER — DATE: 8-1-15	AUGUST 2015	DETAIL NO. 2130

DISCLAIMER:
The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.