


GENERAL NOTES:

1. CARRIER PIPE SHALL BE INSTALLED IN CASING PIPE WITH CASING SPACERS STRAPPED TO CARRIER PIPE. (PIPE BELLS SHALL NOT REST ON STEEL CASING PIPE)
2. CASING SPACERS, INCLUDING PARTS SHALL BE PVC PLASTIC AND/OR 304 STAINLESS STEEL. TO BE MANUFACTURED BY: PIPELINE SEAL AND INSULATOR, INC. OR APPROVED EQUAL.

PIPE SECTION

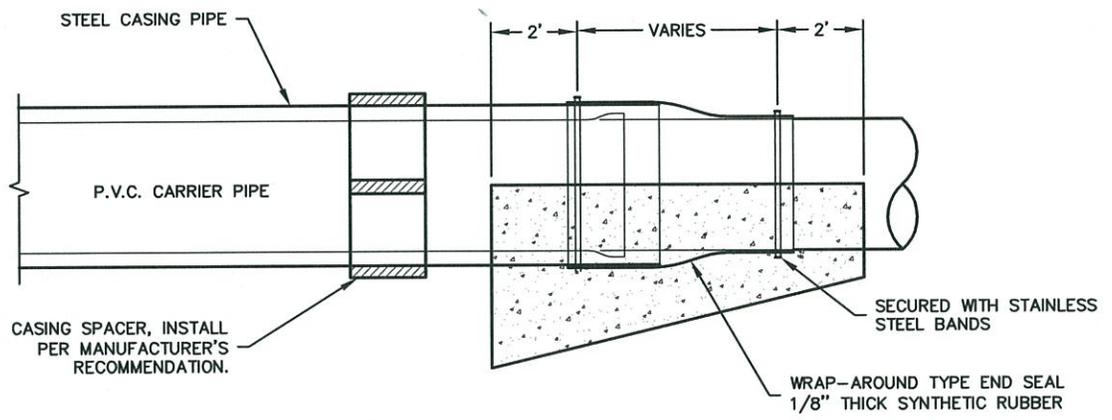

GENERAL NOTE:

1. WRAP-AROUND END SEAL TO BE Model AW, AS MANUFACTURED BY ADVANCED PRODUCTS & SYSTEMS, INC. OR EQUAL

END SEAL

PIPE CASING DETAIL

NOT TO SCALE

DISCLAIMER: The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

| | | |
|---|---|--------------------|
| APPROVED | CITY OF WICHITA FALLS, TX ENGINEERING DIVISION | PIPE CASING DETAIL |
| <i>D. Powell, P.E.</i> CITY ENGINEER | | MARCH 2016 |
| 3-26-16 DATE | | DETAIL NO. 3040-B |