




TRACER WIRE CONNECTOR

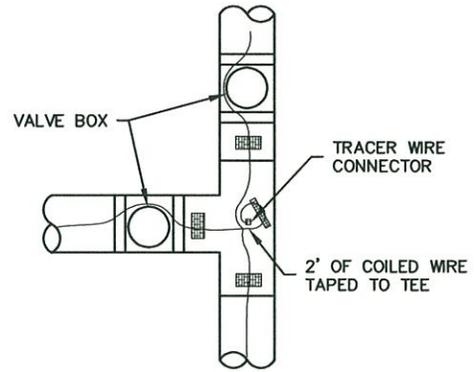

TYPICAL TEE BRANCH

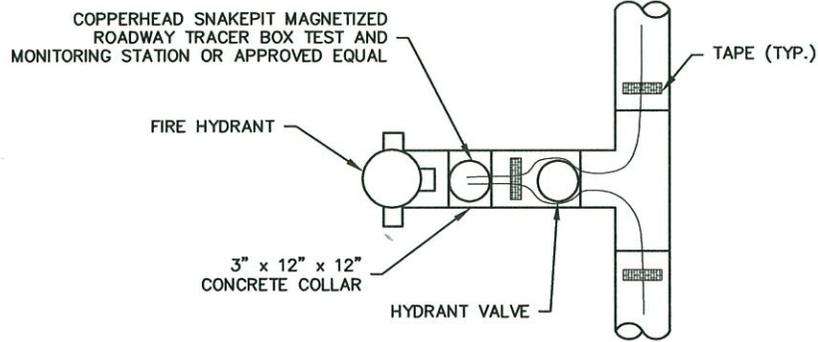

FIRE HYDRANT CONNECTION

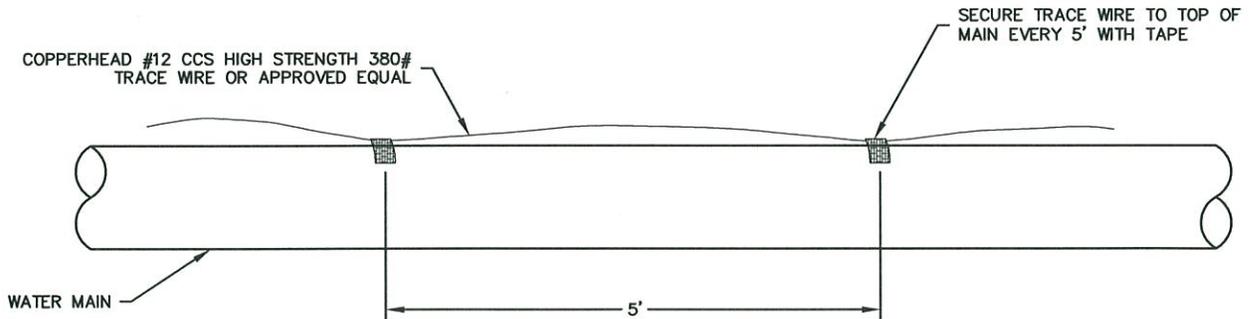

TRACER WIRE INSTALLATION

GENERAL NOTES:

1. TRACER WIRE SHALL BE INSTALLED IN A CONTINUOUS FASHION.
2. TRACER WIRE SHALL BE INSTALLED UNDER POLYWRAP AT ALL FITTINGS, TEES AND VALVES.
3. TRACER WIRE CONNECTORS SHALL BE MINIMIZED WHEN POSSIBLE.
4. INSPECTION AND ADDITIONAL 6' OF WIRE SHALL BE COILED AT ALL END POINTS WITH COPPERHEAD SNAKEBITE WATER-TIGHT OR 3M DBR WIRE CONNECTOR INSTALLED ON END.

NOT TO SCALE

DISCLAIMER: This standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

APPROVED	CITY OF WICHITA FALLS, TX ENGINEERING DIVISION MARCH 2016	TRACER WIRE INSTALLATION
<i>D. J. Powell, P.E.</i> CITY ENGINEER		DETAIL NO. 4015