


DISCLAIMER: The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

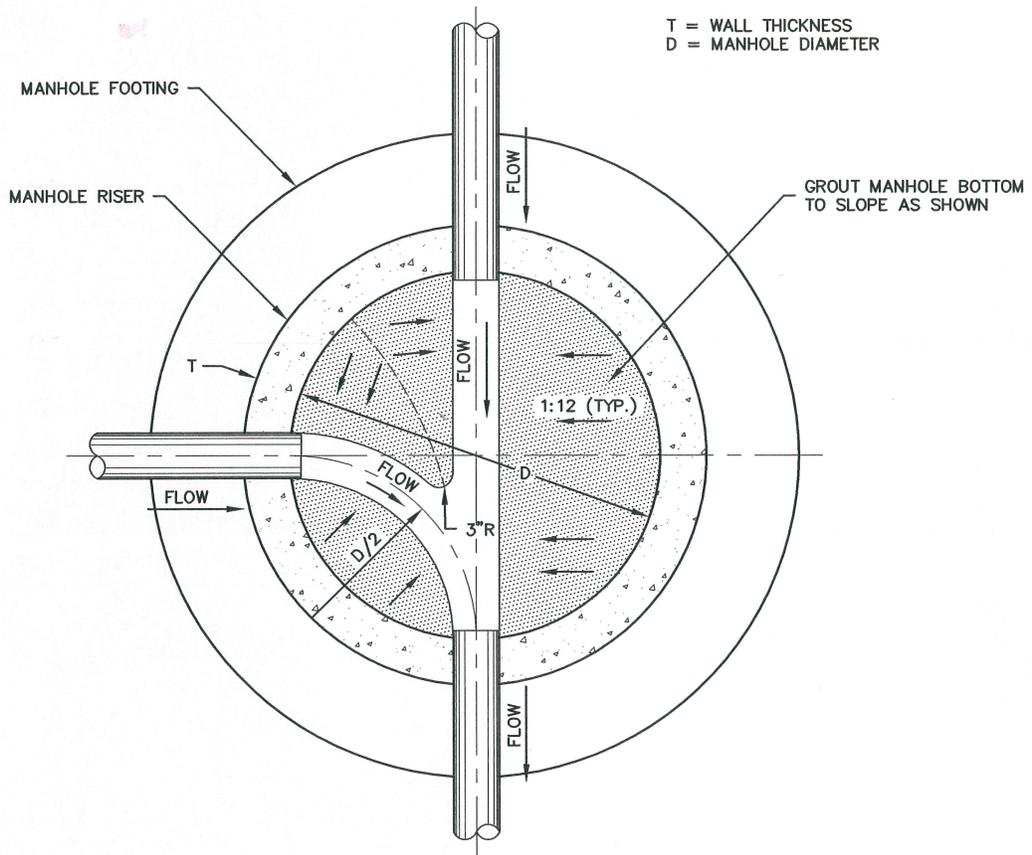

PLAN VIEW

GENERAL NOTES:

1. MANHOLES WITH PIPES OF DIFFERENT SIZES MUST HAVE TOPS OF THE PIPES AT THE SAME ELEVATION AND FLOW CHANNELS IN THE INVERT SLOPED ON AN EVEN SLOPE FROM PIPE TO PIPE PER TCEQ 217.55.
2. SET INFLOW MAIN ELEVATIONS AND GROUT BOTTOM IN MANNER TO PREVENT FREE FALL OF FLUID INTO MANHOLE FROM INFLOW MAINS
3. WHEN A DROP IS APPROVED, PIPE MAIN ENTERING MANHOLE MUST BE CONSTRUCTED WITH EXTERNAL DROP PIPE.

STANDARD MANHOLE  
INVERTS

NOT TO SCALE

APPROVED	CITY OF WICHITA FALLS, TX ENGINEERING DIVISION	STANDARD MANHOLE INVERT INTERSECTION DETAIL	
<i>D. Paul, P.E.</i> CITY ENGINEER		MARCH 2016	DETAIL NO. 5030