


5070 - STANDARD MANHOLE WITH EXTERIOR DROP SYSTEM .DWG

HINGED DUCTILE IRON FRAME AND COVER SEE DETAIL. SET TO ELEVATION SHOWN ON PLANS.

NON-SHRINK GROUT COATING, WHEN NOT IN PAVING

GRADE TO DRAIN. SLOPE FINISHED GRADE 2% MIN. AWAY FROM M.H.

USE PRE-CAST CONCRETE GRADE RINGS AND NON-SHRINK GROUT AS REQUIRED TO RAISE TO GRADE. USE RAM-NEK JOINT SEALER OR SEALANT AS RECOMMENDED BY MANUFACTURER FOR WATERTIGHT CONNECTION. THE FINAL 4"-6" MAXIMUM OF ADJUSTMENT RINGS MAY BE H.D.P.E. OR RECYCLED RING SEALED PER MANUFACTURES SPECIFICATIONS.

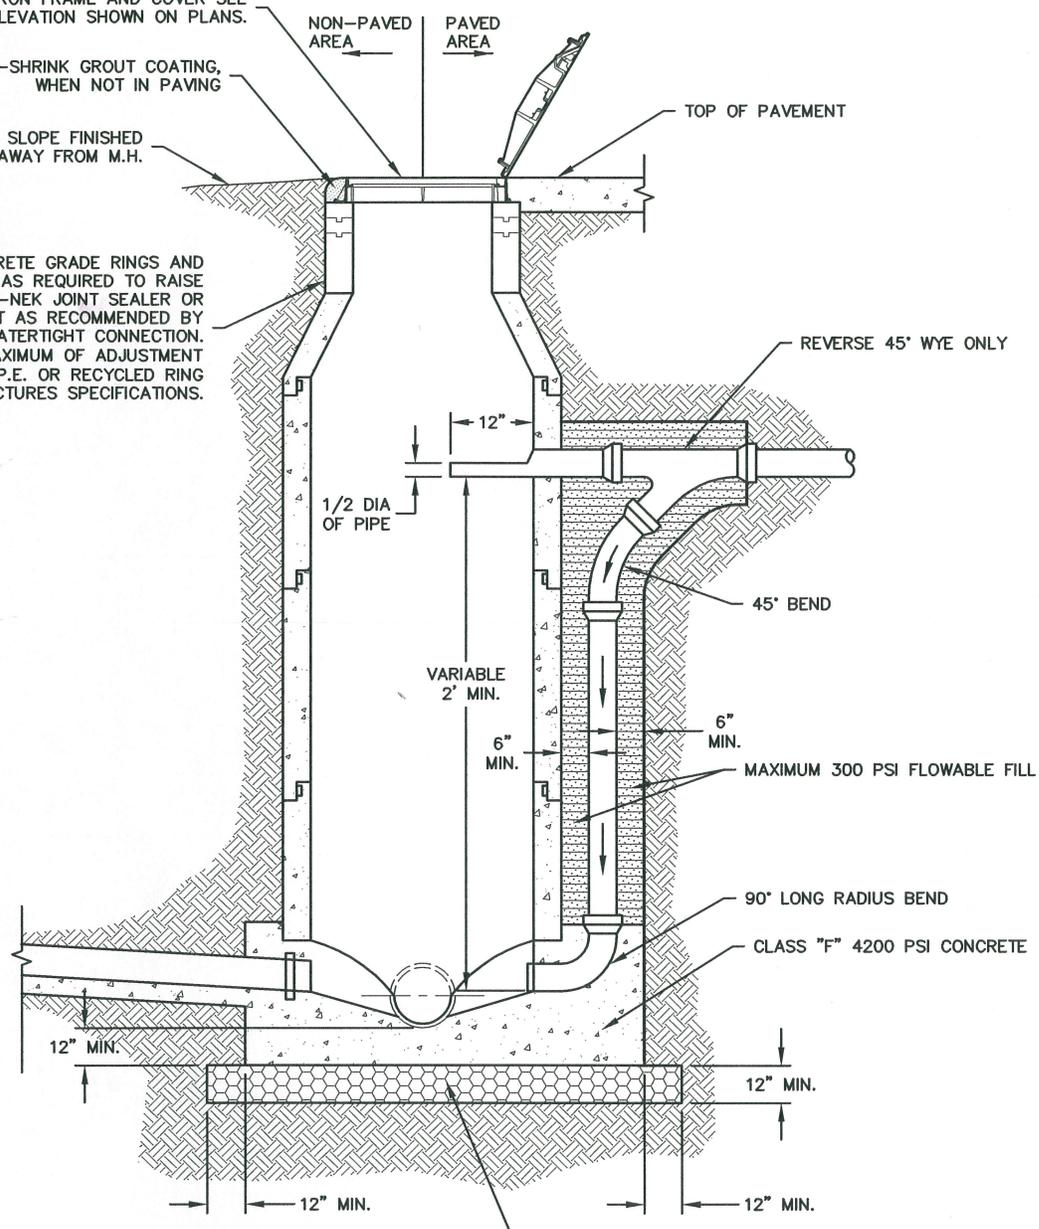

GENERAL NOTES:

1. SEE STANDARD MANHOLE DETAIL FOR ADDITIONAL DETAILS OF MANHOLE.

ROCK FOUNDATION COMPLYING WITH STANDARD SPECIFICATION 504.2.2.1.(a) COARSE CRUSHED STONE.

**STANDARD MANHOLE  
EXTERIOR DROP SYSTEM**  
NOT TO SCALE

NOT TO SCALE

DISCLAIMER: The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

<p>APPROVED</p> <p><i>David Paul, P.E.</i> 6-10-16</p> <p>CITY ENGINEER DATE</p>	<p>CITY OF WICHITA FALLS, TX ENGINEERING DIVISION</p> <p>MARCH 2016</p>	<p>STANDARD MANHOLE EXTERIOR DROP SYSTEM</p> <p>DETAIL NO. 5070</p>
--	---	---