


PLAN

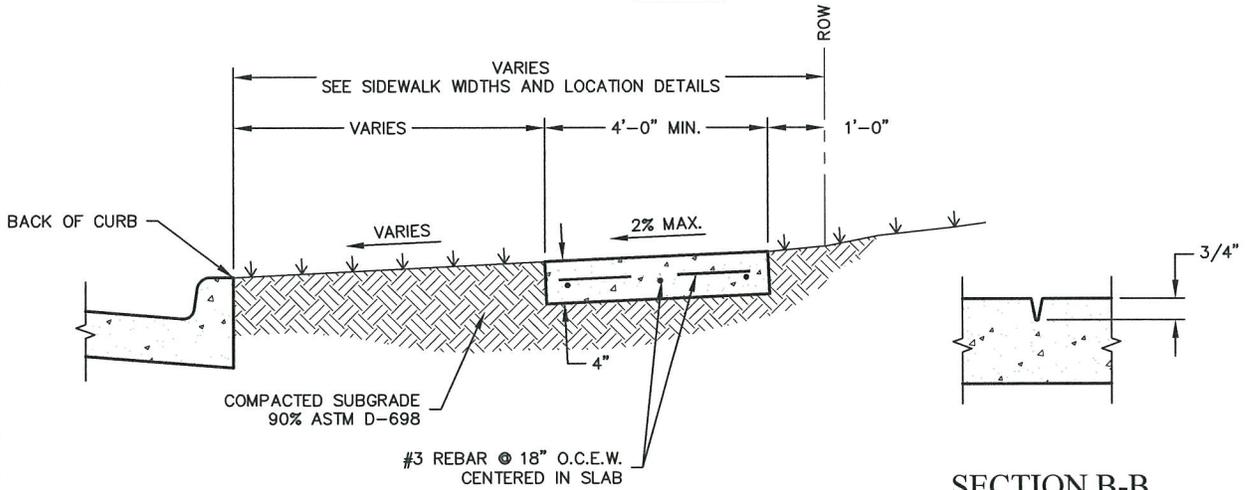

SECTION A-A

SECTION B-B
CONTRACTION JOINT

GENERAL NOTES:

1. SIDEWALK REINFORCING (EXCLUDING DRIVE APPROACHES) SHALL BE #3 BARS @ 18" O.C.E.W. OR #4 BARS ON 24" O.C.
2. ALL CONCRETE SHALL BE CLASS "A", (COMPRESSIVE STRENGTH OF 3,000 PSI. @ 28 DAYS.)
3. SAND SHALL NOT BE ACCEPTED AS COMPACTED SUBGRADE. SAND WILL BE ALLOWED FOR LEVEL-UP ONLY.
4. ANY UTILITY BOXES OR MANHOLES WITHIN THE SIDEWALK MUST BE ADJUSTED BY THE CITY UTILITY DEPARTMENT, OR OWNER OF UTILITY, TO BE FLUSH WITH FINISH GRADE, OR RELOCATED OUT OF THE SIDEWALK TO THE PROPER GRADE. ALL ADJUSTMENT COST WILL BE THE RESPONSIBILITY OF THE CONTRACTOR, OR THE OWNER INSTALLING THE SIDEWALK.
5. CROSS SLOPE AT DRIVE APPROACHES AND RAMPS MUST COMPLY WITH ADA REQUIREMENTS. (1 INCH PER FOOT MAXIMUM)
6. IF SIDEWALK IS PLACED ADJACENT TO CURB, MINIMUM WIDTH SHALL BE 6'.
7. PLACE SIDEWALK 1' OFF ROW LINE. PROVIDE 5' MINIMUM WIDTH SIDEWALK IN COMMERCIAL AREAS WITH HEAVY PEDESTRIAN MOVEMENTS.
8. SIDEWALKS INSTALLED WITHIN TXDOT RIGHT OF WAY SHALL BE A MINIMUM WIDTH OF 5' AND MEET REQUIREMENTS OF TXDOT PEDESTRIAN STANDARDS.

SIDEWALK

NOT TO SCALE

DISCLAIMER: The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

APPROVED	CITY OF WICHITA FALLS, TX ENGINEERING DIVISION	SIDEWALK
 CITY ENGINEER		APRIL 2015 DATE