



ISOMETRIC PLAN VIEW

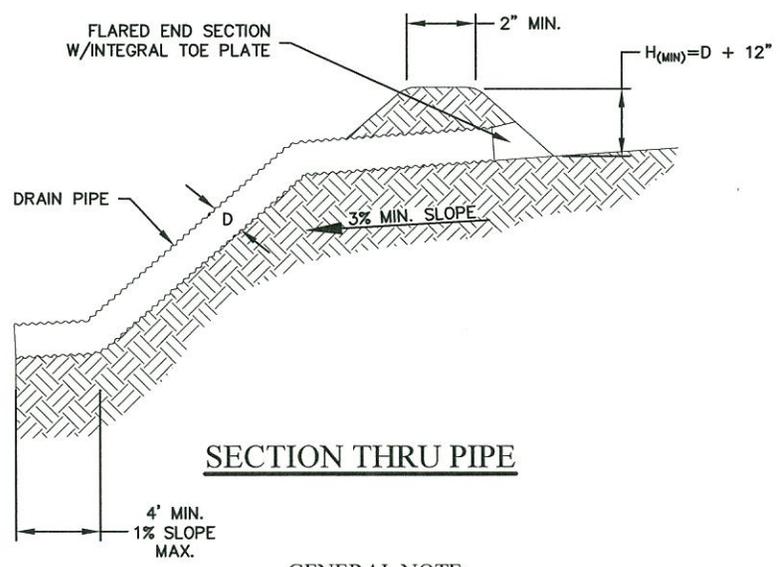

SECTION THRU PIPE

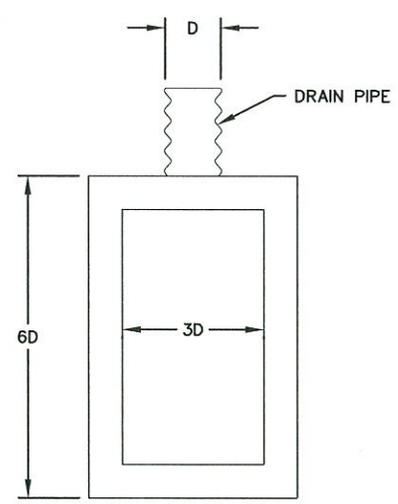

RIPRAP APRON PLAN VIEW

GENERAL NOTE:

1. RIPRAP SHALL CONSIST OF 50 TO 150 POUND STONES PLACED IN A LAYER OF NOT LESS THAN 12 INCHES. THE DEPTH OF THE APRON SHALL EQUAL THE PIPE DIAMETER BUT IN NO CASE SHALL IT BE LESS THAN 12 INCHES.

PIPE SLOPE DRAIN

NOT TO SCALE

DISCLAIMER: The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

<p>APPROVED</p> <p>CITY ENGINEER</p>	<p>12-10-14</p> <p>DATE</p>	<p>CITY OF WICHITA FALLS, TX ENGINEERING DIVISION</p> <p>JANUARY 2015</p>	<p>PIPE SLOPE DRAIN</p>
		<p>DETAIL NO. 1110</p>	